


SIX WIRE TOTALIZED METERING

FOR USE WITH CURRENT TRANSFORMERS

4.06.4

M670DM

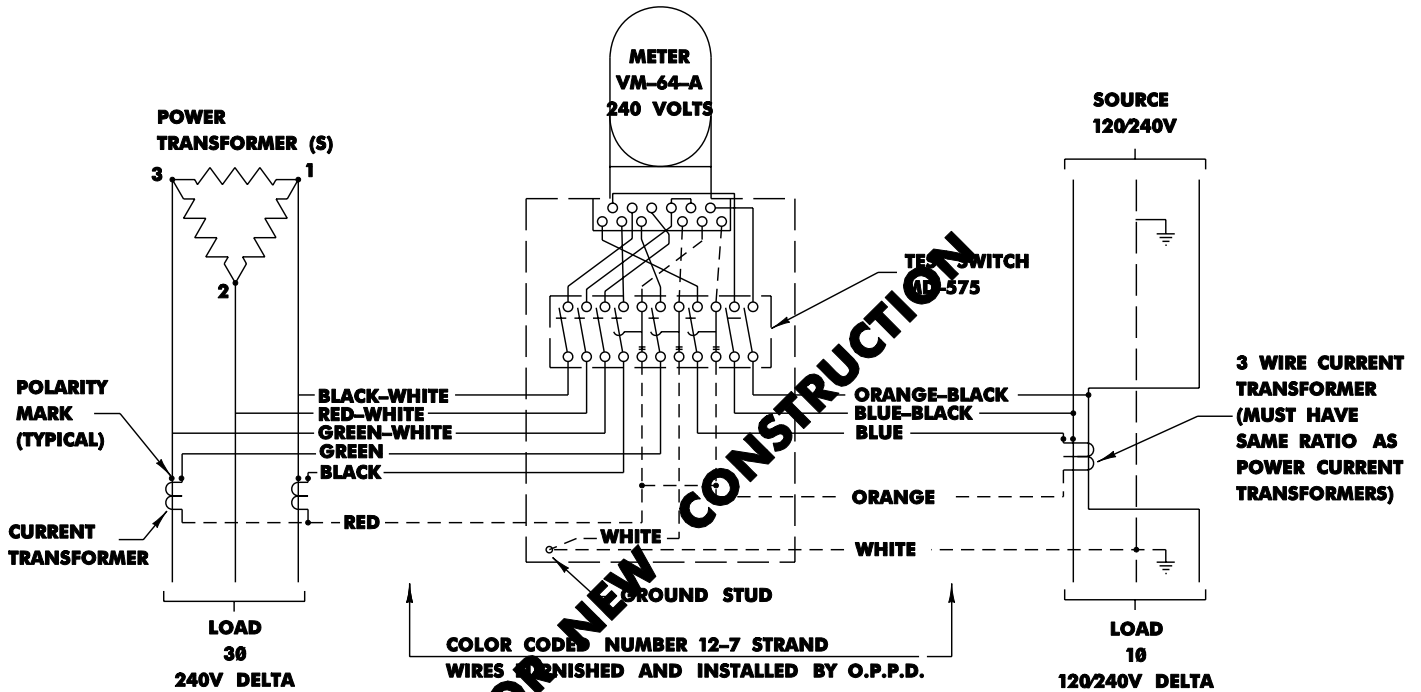

NOT FOR NEW CONSTRUCTION

NOTES:

CUSTOMER TO FURNISH AND INSTALL "NATIONAL ELECTRICAL CODE" GRADE STEEL CABINET OF ADEQUATE SIZE FOR THE CURRENT TRANSFORMERS AND ALL WIRING CONNECTIONS

SERVICE ENTRANCE NEUTRAL MUST BE BONDED TO CURRENT TRANSFORMER CABINET

CUSTOMER TO FURNISH AND INSTALL 1 1/4" CONDUIT FROM CURRENT TRANSFORMER CABINET TO METER CABINET

FOR LUG CONNECTIONS ON CURRENT TRANSFORMERS UP TO 600 AMPERES MINIMUM BOLT SIZE 3/8" OVER 600 AMPERES MINIMUM BOLT SIZE 1/2"

