


DUCTED SERVICE REQUIREMENTS

7.02.2

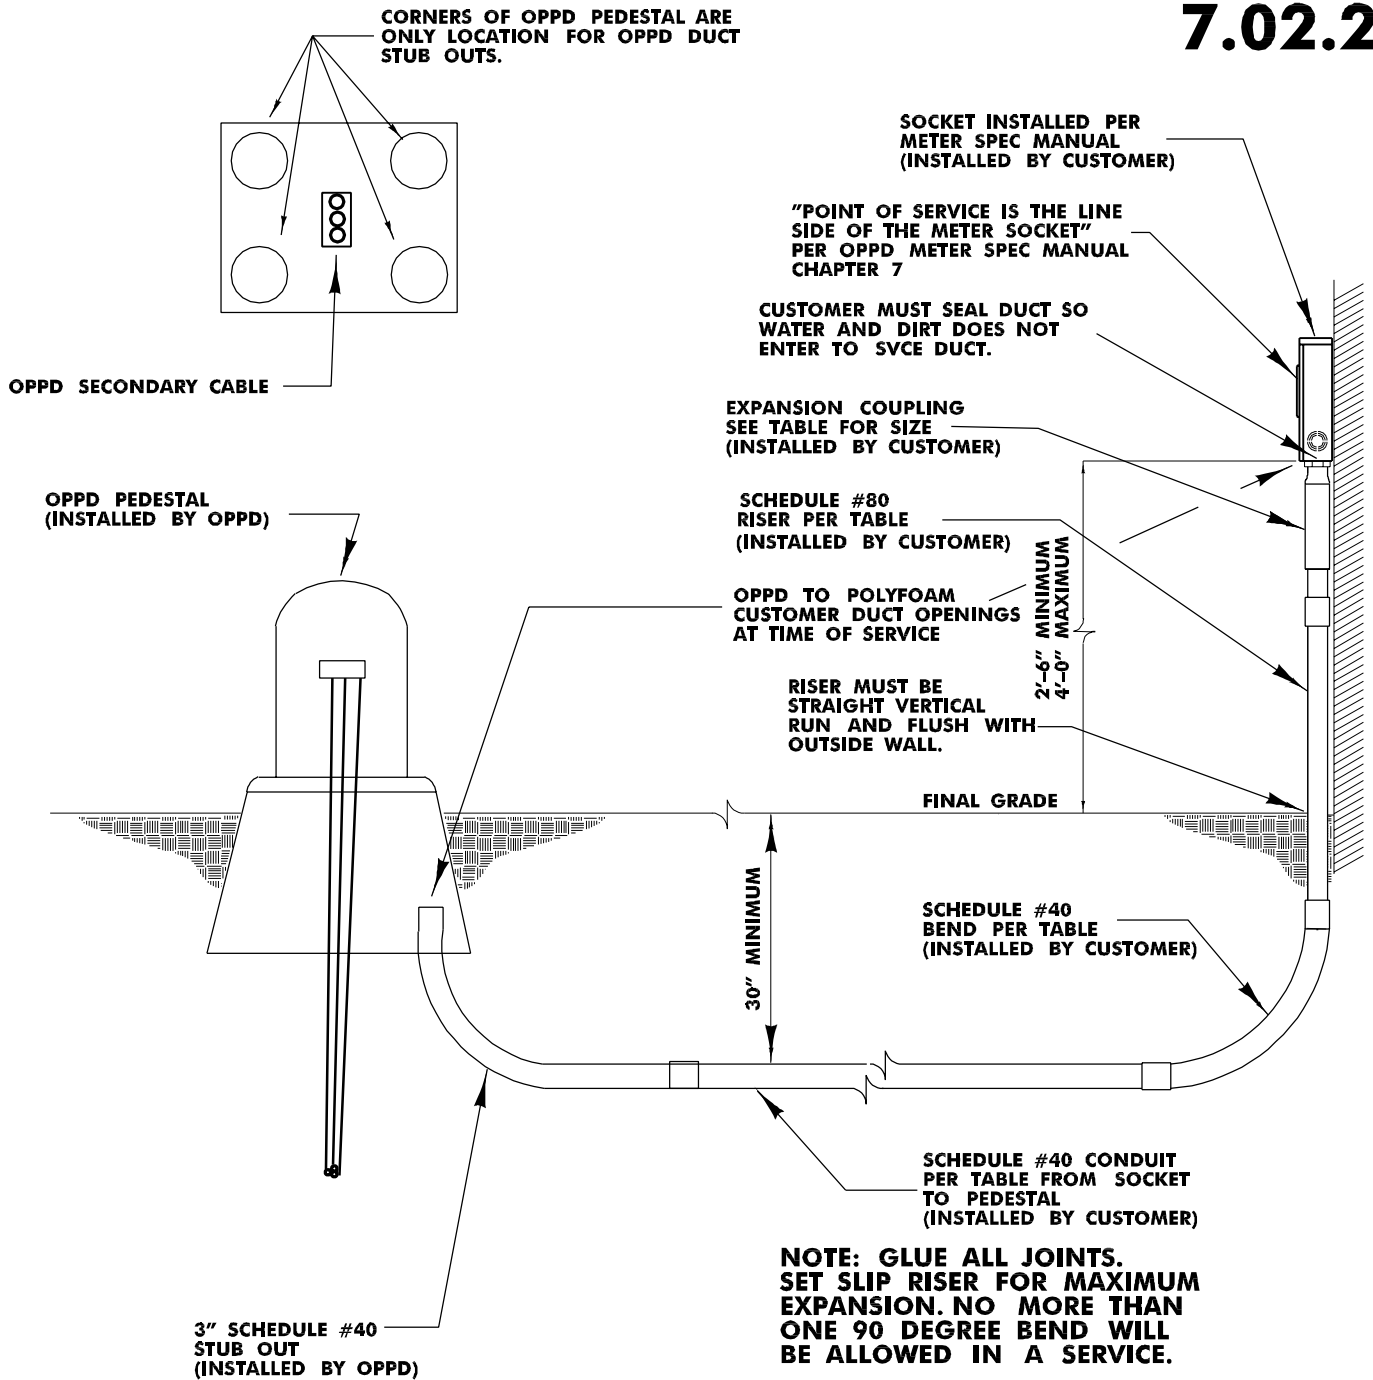

TABLE

SERVICE SIZE	MINIMUM COVER OVER DUCT	MINIMUM RADIUS OF ALL BENDS	MINIMUM DUCT SIZE
200A HOUSE SERVICE	30 INCHES	24 INCHES	2 1/2 INCHES
320A HOUSE SERVICE	30 INCHES	24 INCHES	3 INCHES