


FOUR WIRE DELTA METERING

FOR USE WITH CURRENT TRANSFORMERS

4.06.19

RMV ONLY: M520D

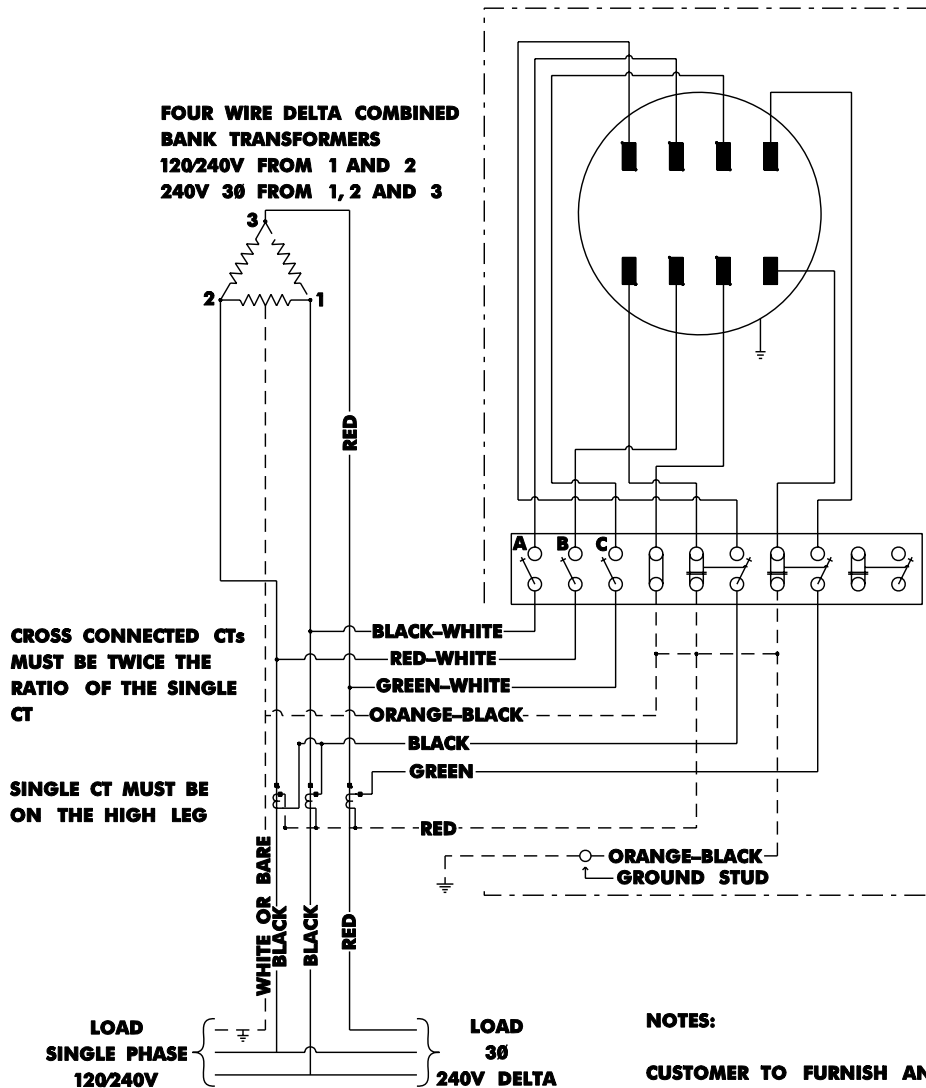

NOTES:

CUSTOMER TO FURNISH AND INSTALL "NATIONAL ELECTRICAL CODE" GRADE STEEL CABINET OF ADEQUATE SIZE FOR THE CURRENT TRANSFORMERS AND ALL WIRING CONNECTIONS

SERVICE ENTRANCE NEUTRAL MUST BE BONDED TO CURRENT TRANSFORMER CABINET
 CUSTOMER TO FURNISH AND INSTALL 1" CONDUIT FROM CT CABINET TO METER TEST CABINET

FOR LUG CONNECTIONS ON CURRENT TRANSFORMERS UP TO 600 AMPERES MINIMUM BOLT SIZE 3/8"
 OVER 600 AMPERES MINIMUM BOLT SIZE 1/2"